



# DUAL SUNNY ISLAND WITH 3 CLASSICS

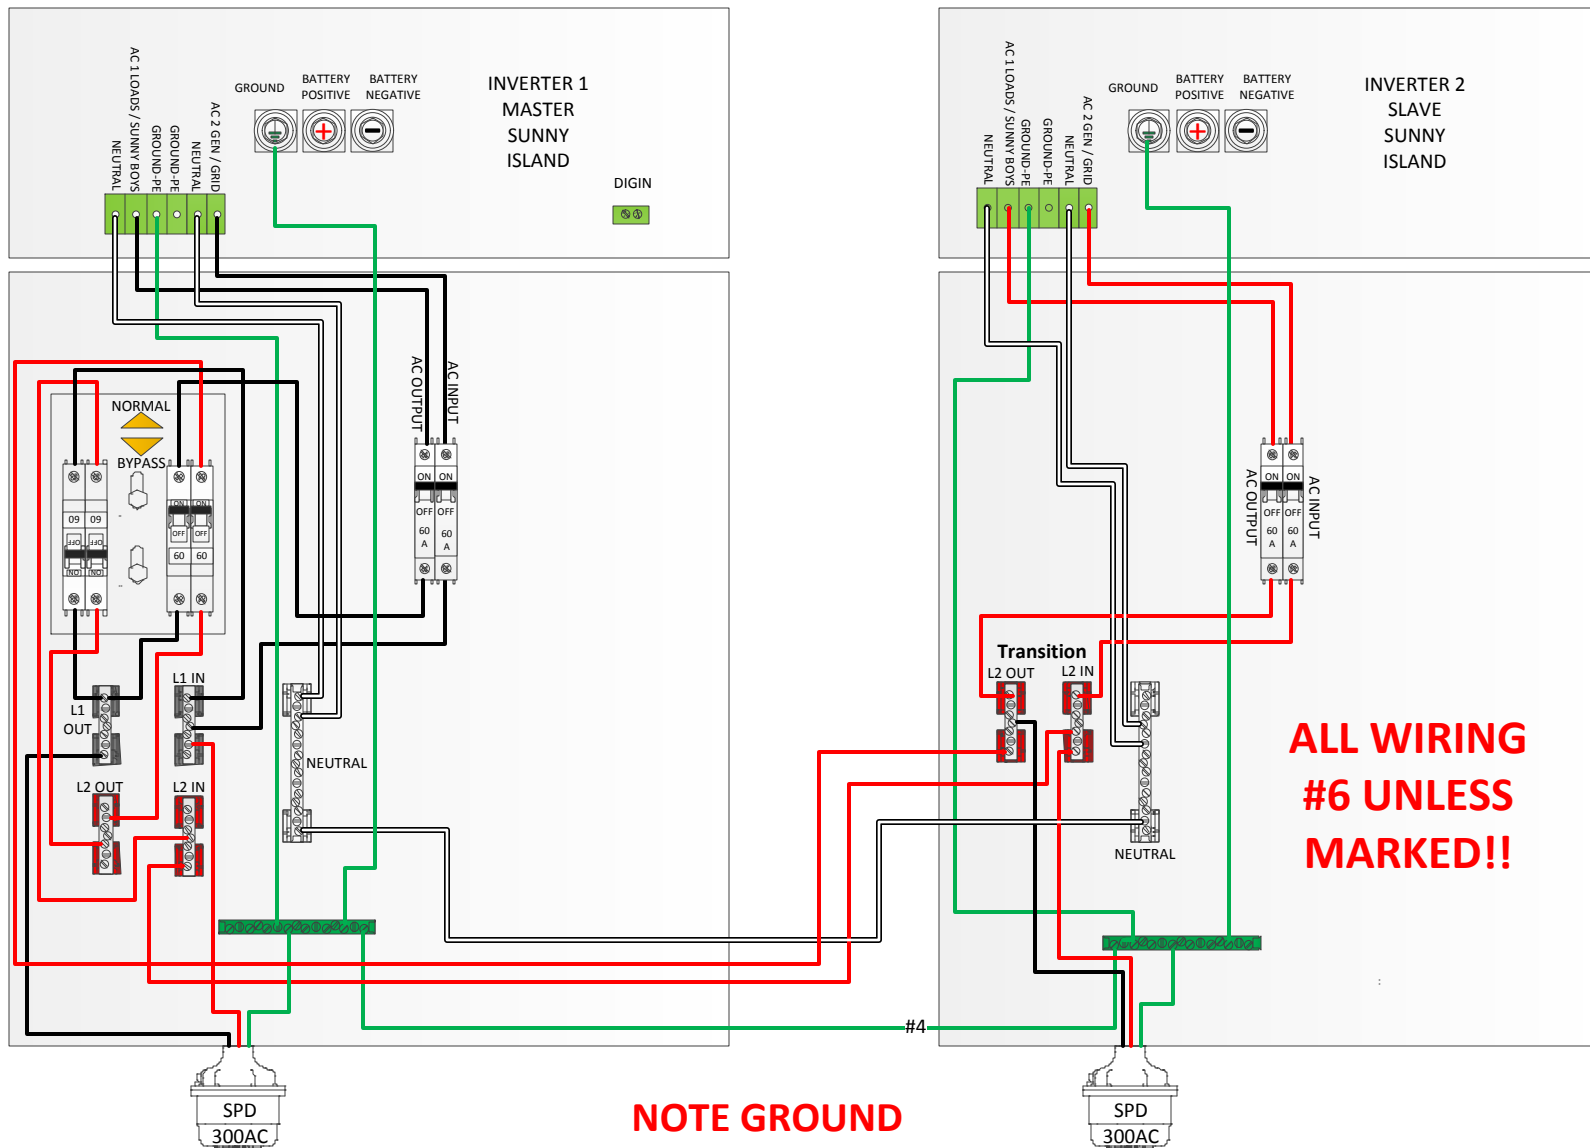


**NOTE GROUND  
INTERCONNECT IS #4**

# DC AND COMMUNICATION CABLES FACTORY INSTALLED BY MIDNITE SOLAR

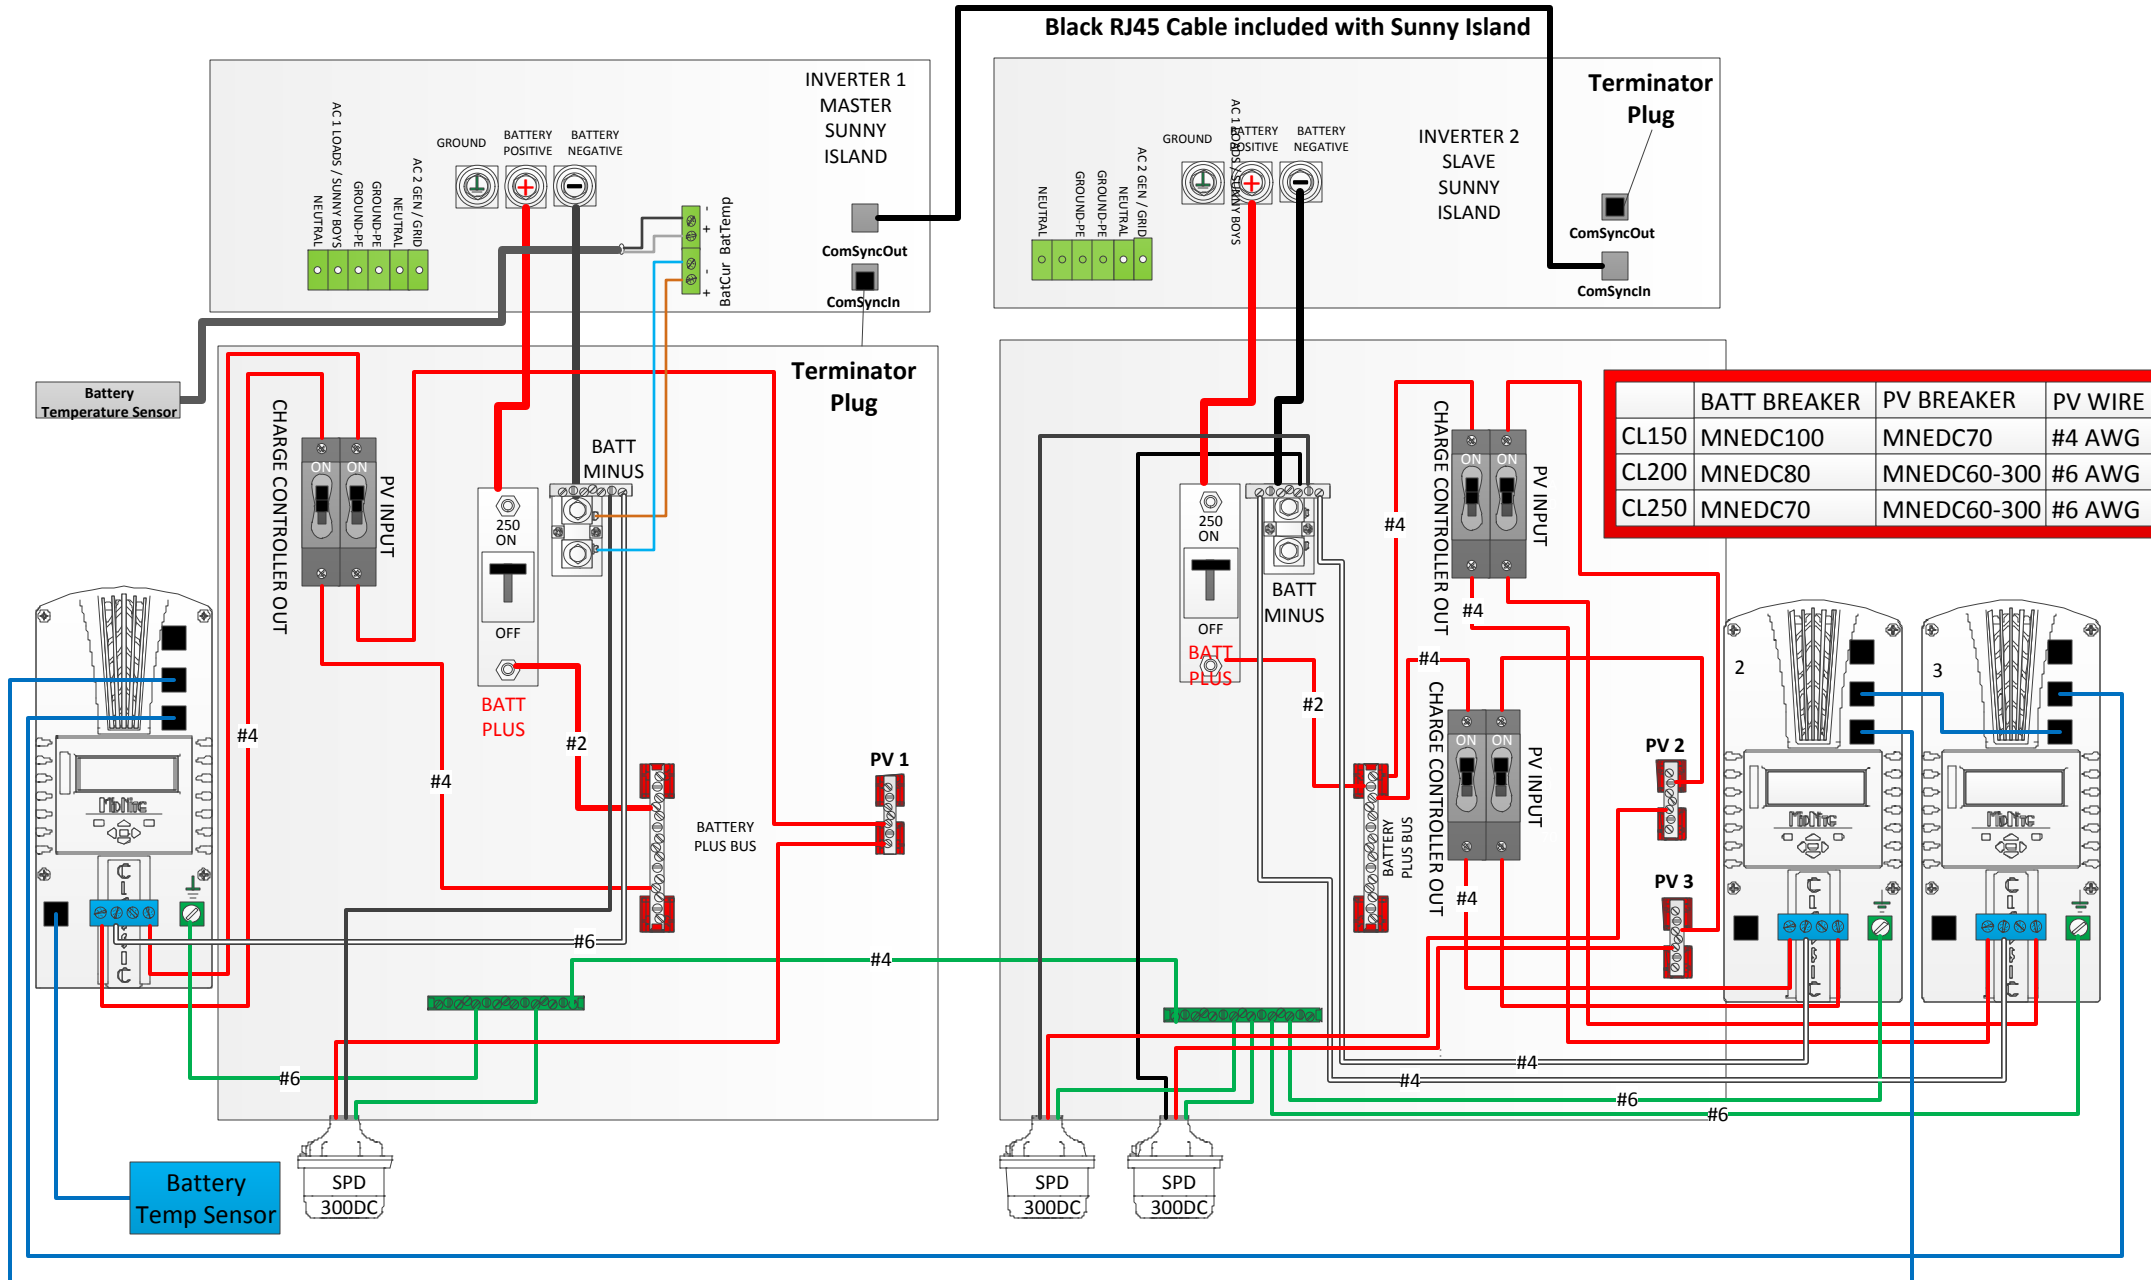

# AC WIRING TO BE DONE BY CUSTOMER

System must be grounded per NEC specifications

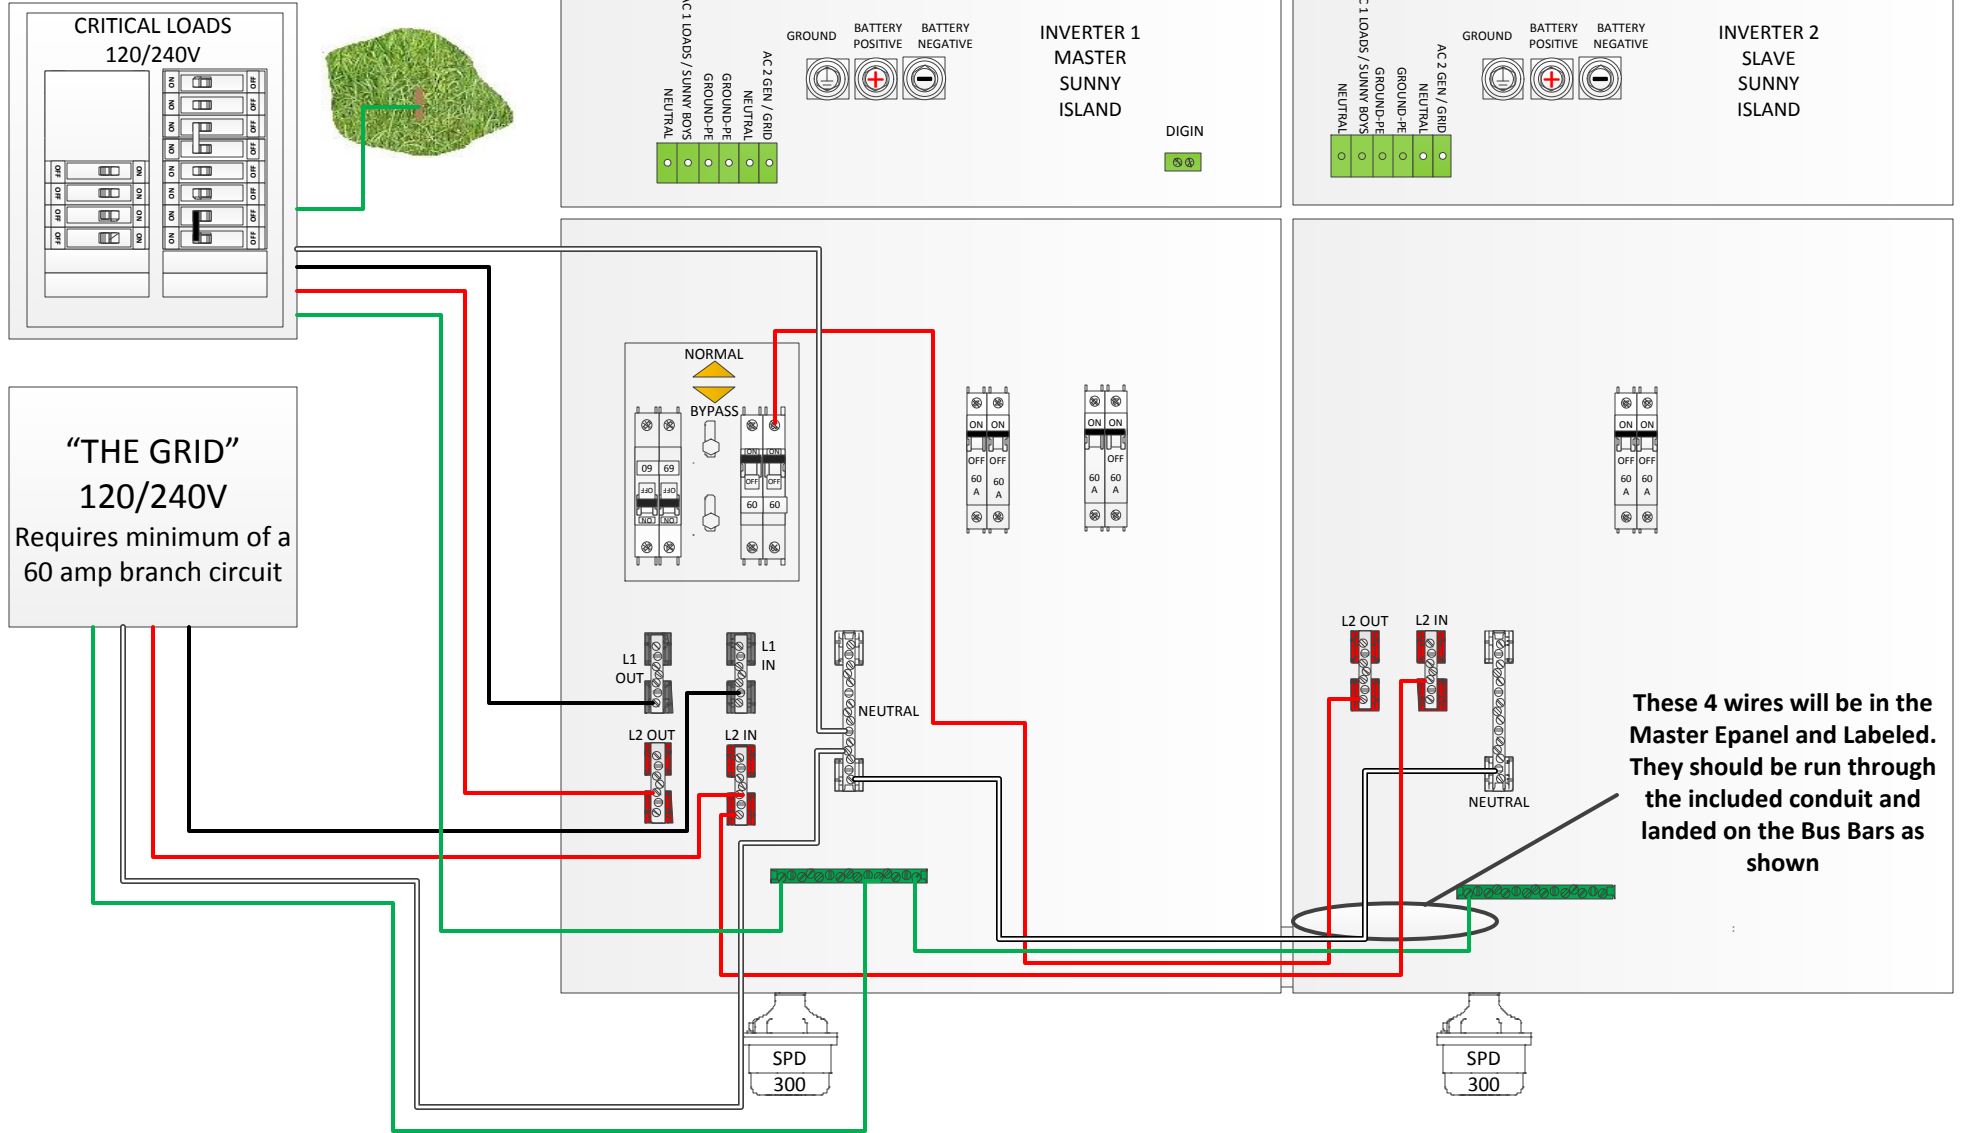

These 4 wires will be in the Master Epanel and Labeled. They should be run through the included conduit and landed on the Bus Bars as shown

